



TEMPORARY PEDESTRIAN PATHWAY
N.T.S.

- NOTES:
- 1). PROVIDE 4'-0" WIDE TEMPORARY PATHWAY, SUPPLY PCC, BITUMINOUS PAVEMENT, TEMPORARY ROADWAY MATERIAL (TRM), OR COMPACTED MILLINGS TO A MINIMUM DEPTH OF 4", FLUSH WITH EXISTING GRADE.
 - 2). MAINTAIN A UNIFORM MATERIAL THAT IS FIRM, STABLE, AND SLIP RESISTANT.
 - 3). IN THE EVENT THAT THE WALKING SURFACE OF THE TEMPORARY SIDEWALK IS LOCATED MORE THAN 30" FROM GRADE AT ANY POINT ALONG THE PROPOSED PATH, PROVIDE TYPE 2 TEMPORARY SIDEWALK.
 - 4). MAXIMUM ALLOWABLE RUNNING SLOPE NOT TO EXCEED 5%. MAXIMUM ALLOWABLE CROSS SLOPE NOT TO EXCEED 2% AND VERTICAL SURFACE DISCONTINUITIES NOT TO EXCEED 1/4".


EXCAVATE SOIL TO ALLOW BEGINNING AND ENDING 8' SECTIONS OF BOARDWALK TO BE INSTALLED FLUSH WITH EXISTING SIDEWALK

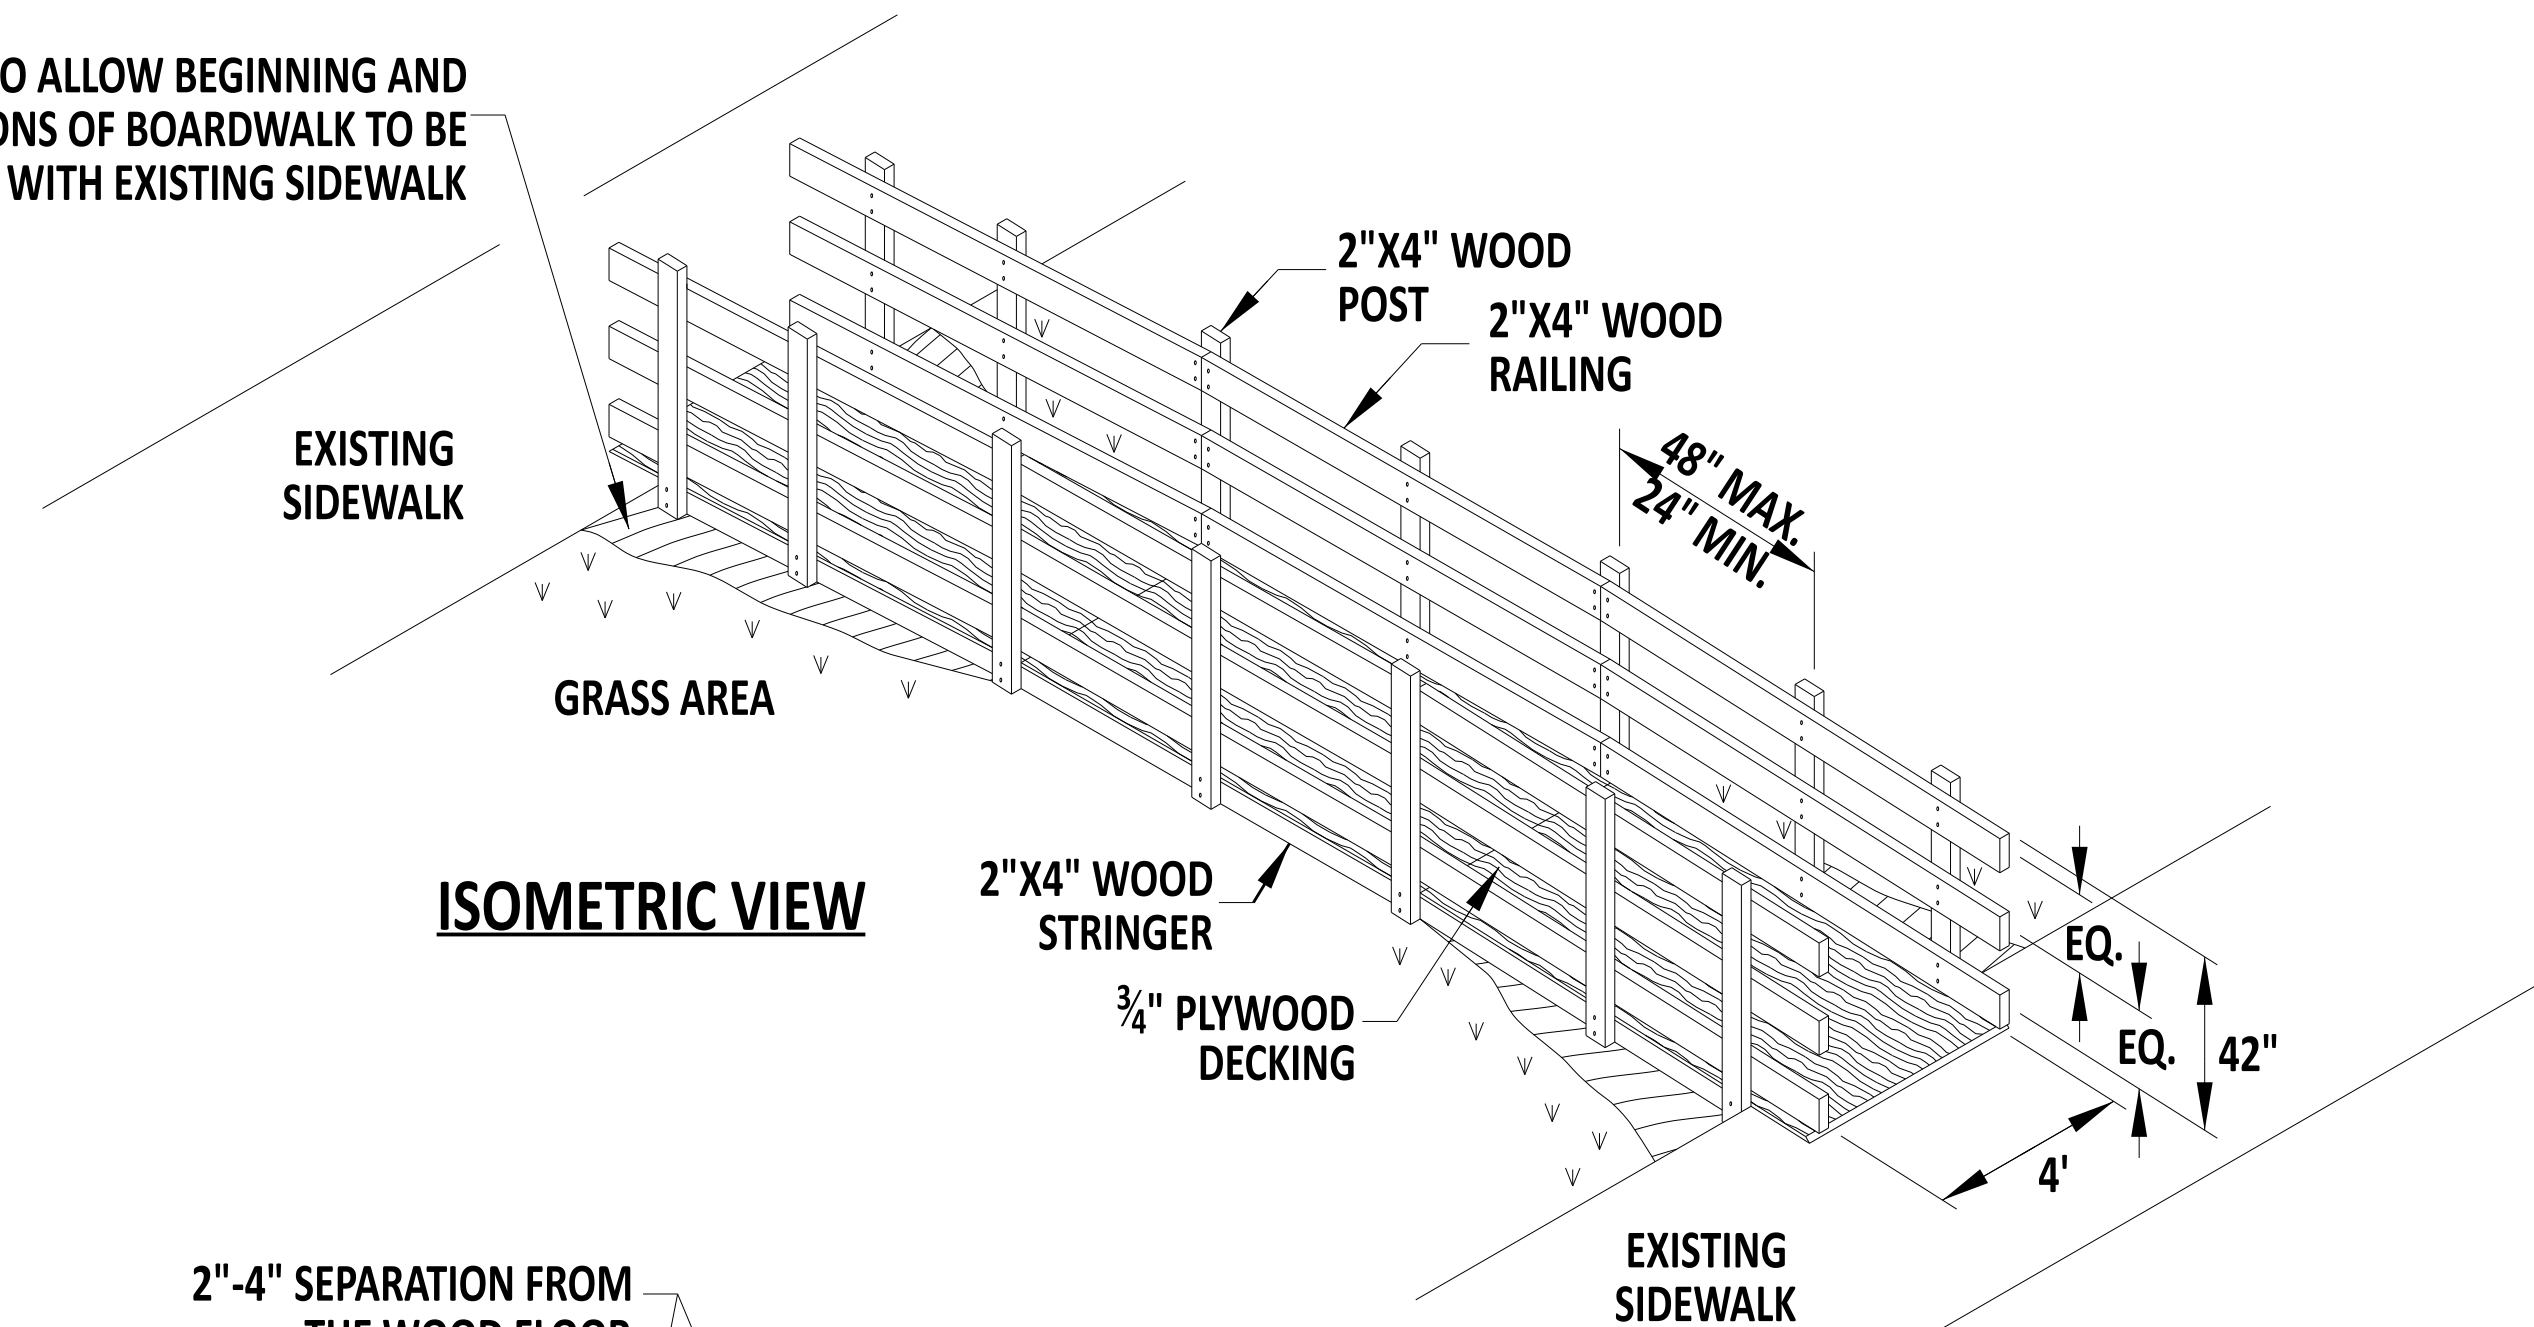

ISOMETRIC VIEW

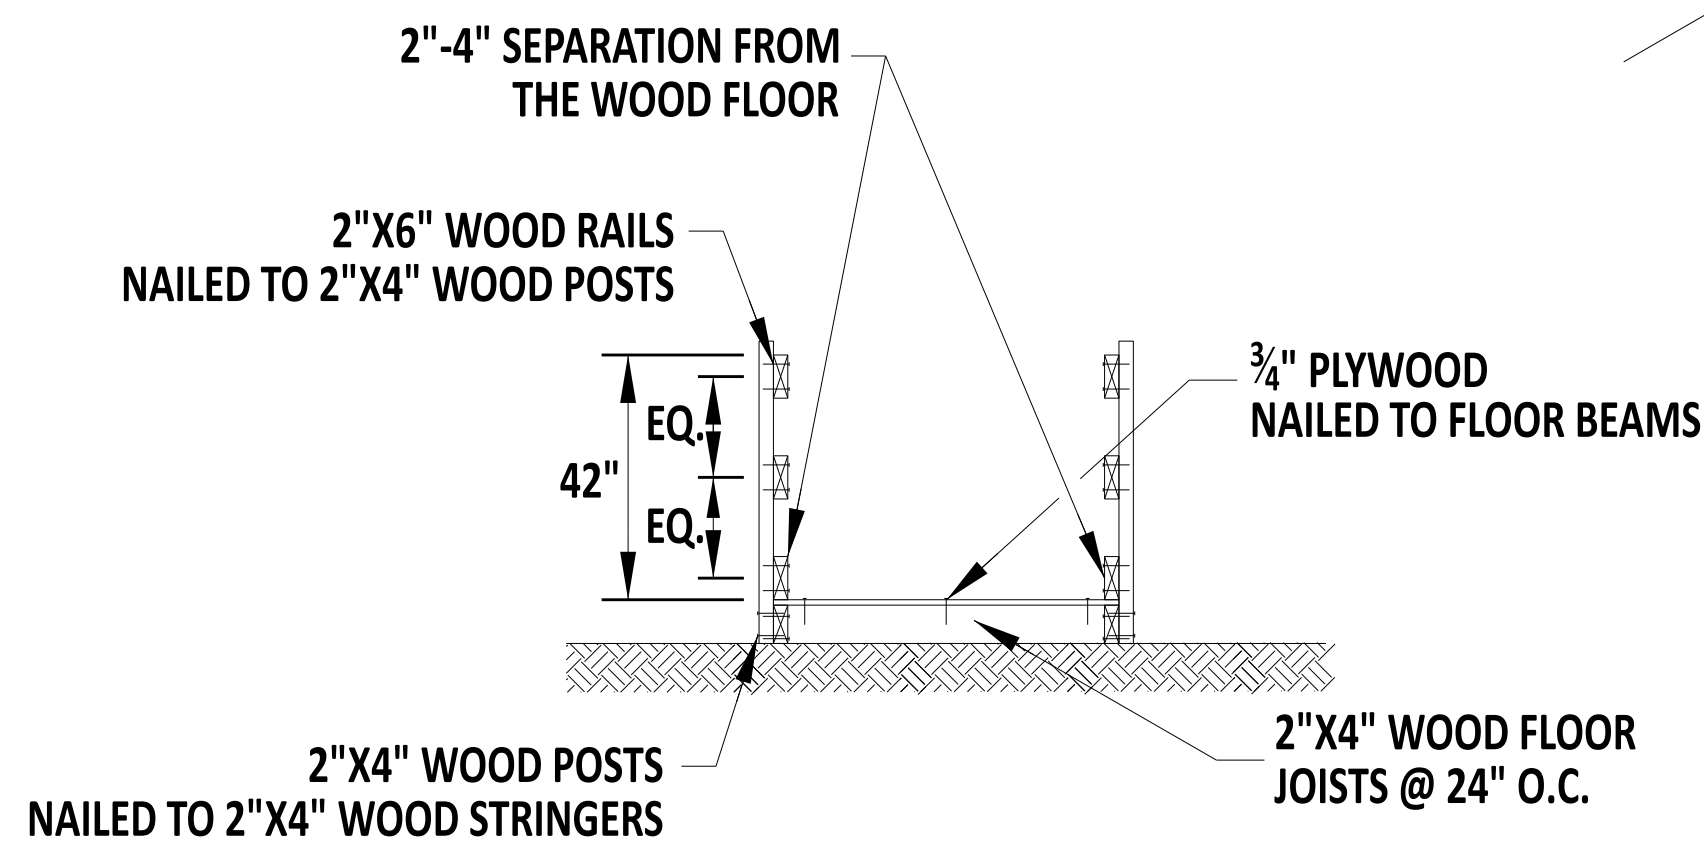

SECTION VIEW

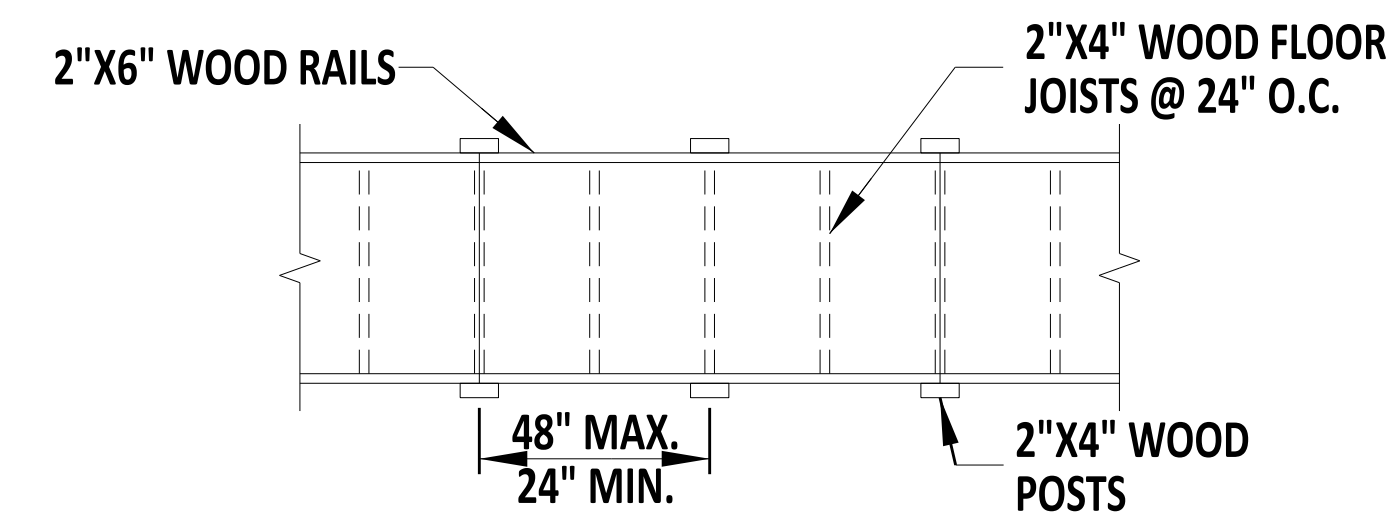

PLAN VIEW

TEMPORARY SIDEWALK DETAIL - TYPE 2
N.T.S.

- NOTES:
1. MAXIMUM ALLOWABLE RUNNING SLOPE NOT TO EXCEED 5%. MAXIMUM ALLOWABLE CROSS SLOPE NOT TO EXCEED 2% AND VERTICAL SURFACE DISCONTINUITIES NOT TO EXCEED 1/4".
 2. MAINTAIN A UNIFORM MATERIAL THAT IS FIRM, STABLE, AND SLIP RESISTANT.



Andrew Short
ENGINEERING SUPPORT DATE 12/22/2023

RECOMMENDED

TEMPORARY PEDESTRIAN PATHWAY

STANDARD NO. M-13 (2024) SHT. 1 OF 1

REVIEWED

[Signature]
DEPUTY DIRECTOR - DESIGN

22 December 2023
DATE

APPROVED

[Signature]
CHIEF ENGINEER

01/11/2024
DATE